


MPUF2H08

UNDER-SLAB FLOOR FIRE BARRIER
 2 HOUR RATED
 MAXIMUM OPENING 8" (203mm)
 INTERTEK LISTING # BA/EC 120-02

COVER IS REQUIRED TO MAINTAIN
 2 HOUR RATING (BY OTHERS)
 SEE NOTE

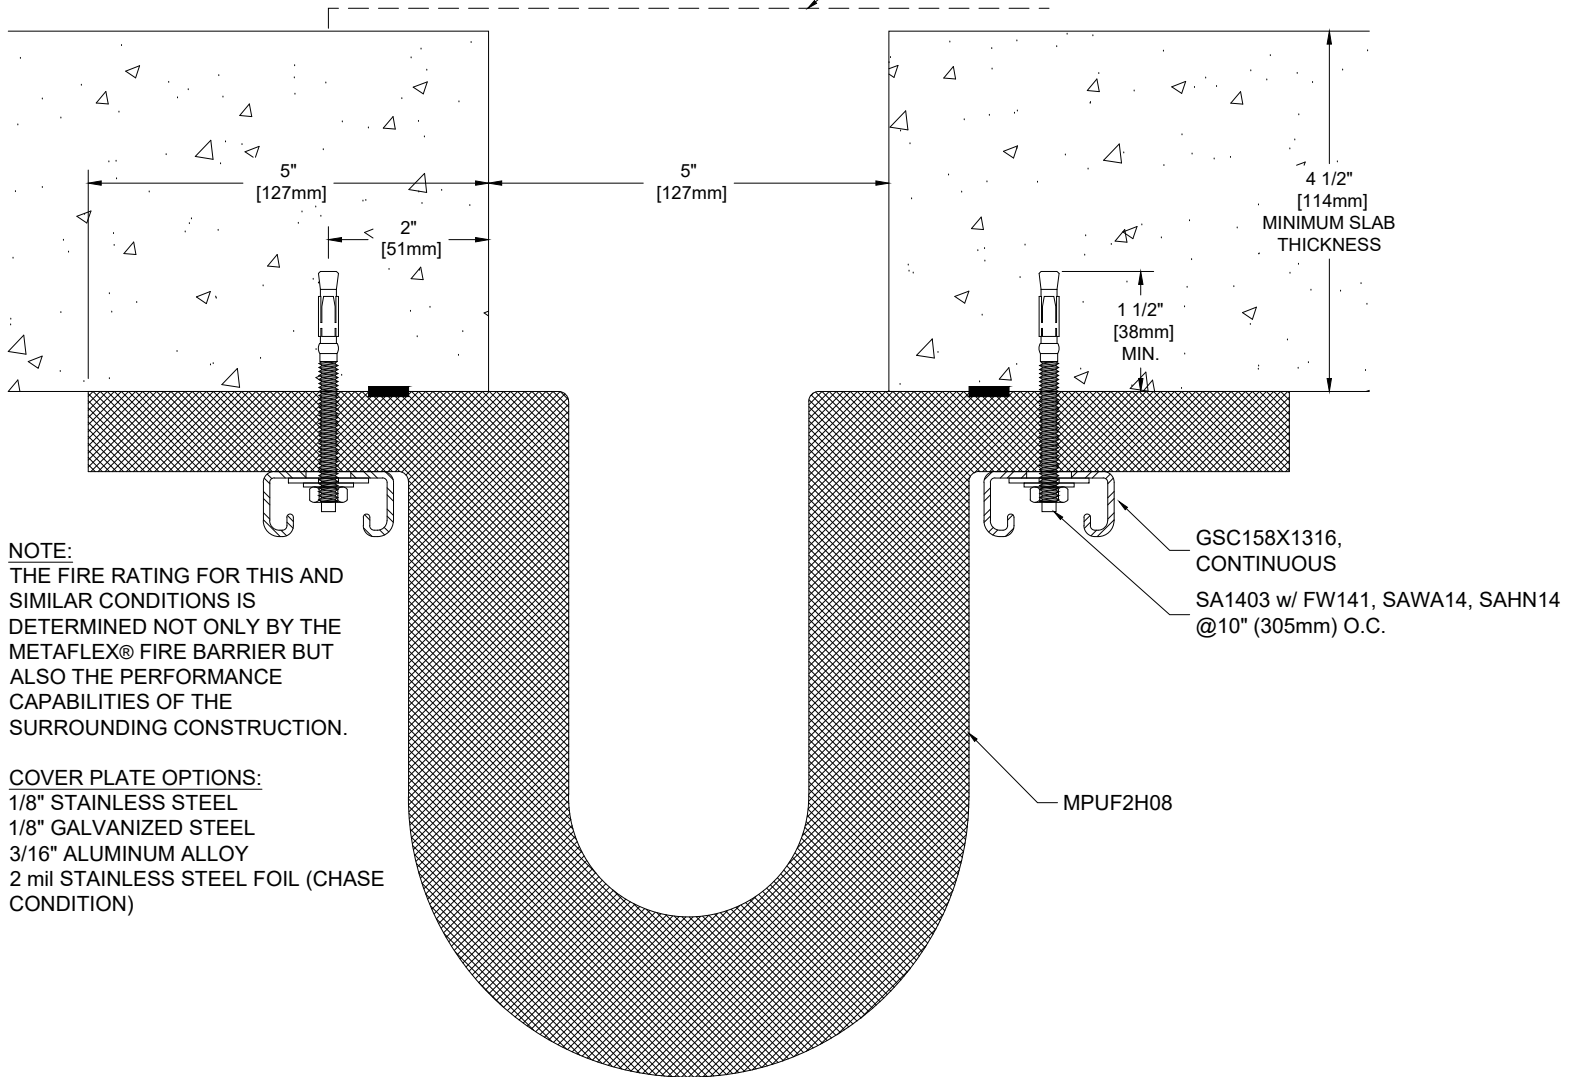

NOTE:
 THE FIRE RATING FOR THIS AND
 SIMILAR CONDITIONS IS
 DETERMINED NOT ONLY BY THE
 METAFLEX® FIRE BARRIER BUT
 ALSO THE PERFORMANCE
 CAPABILITIES OF THE
 SURROUNDING CONSTRUCTION.

COVER PLATE OPTIONS:
 1/8" STAINLESS STEEL
 1/8" GALVANIZED STEEL
 3/16" ALUMINUM ALLOY
 2 mil STAINLESS STEEL FOIL (CHASE
 CONDITION)

GSC158X1316,
 CONTINUOUS
 SA1403 w/ FW141, SAWA14, SAHN14
 @10" (305mm) O.C.

MPUF2H08

| | |
|-----------------|------------|
| Project: | |
| Customer: | |
| SO# | |
| Date: | |
| Page ___ of ___ | Scale: NTS |

| Length | Qty. | Color |
|--------|------|-------|
| | | |
| | | |
| | | |
| | | |

Drawn By: DEB



A CSW Industrials Company

The information contained herein is the proprietary property of BALCO®. No portion of it may be reproduced by any means or used in any form except for the purpose for which it was furnished. All rights of design and invention are hereby reserved.

REV. - 07/14/20