


MPUF2H18
 UNDER-SLAB FLOOR FIRE BARRIER
 2 HOUR RATED
 MAXIMUM OPENING 18" (457mm)
 INTERTEK LISTING # BA/EC 120-02

COVER IS REQUIRED TO MAINTAIN
 2 HOUR RATING (BY OTHERS)
 SEE NOTE

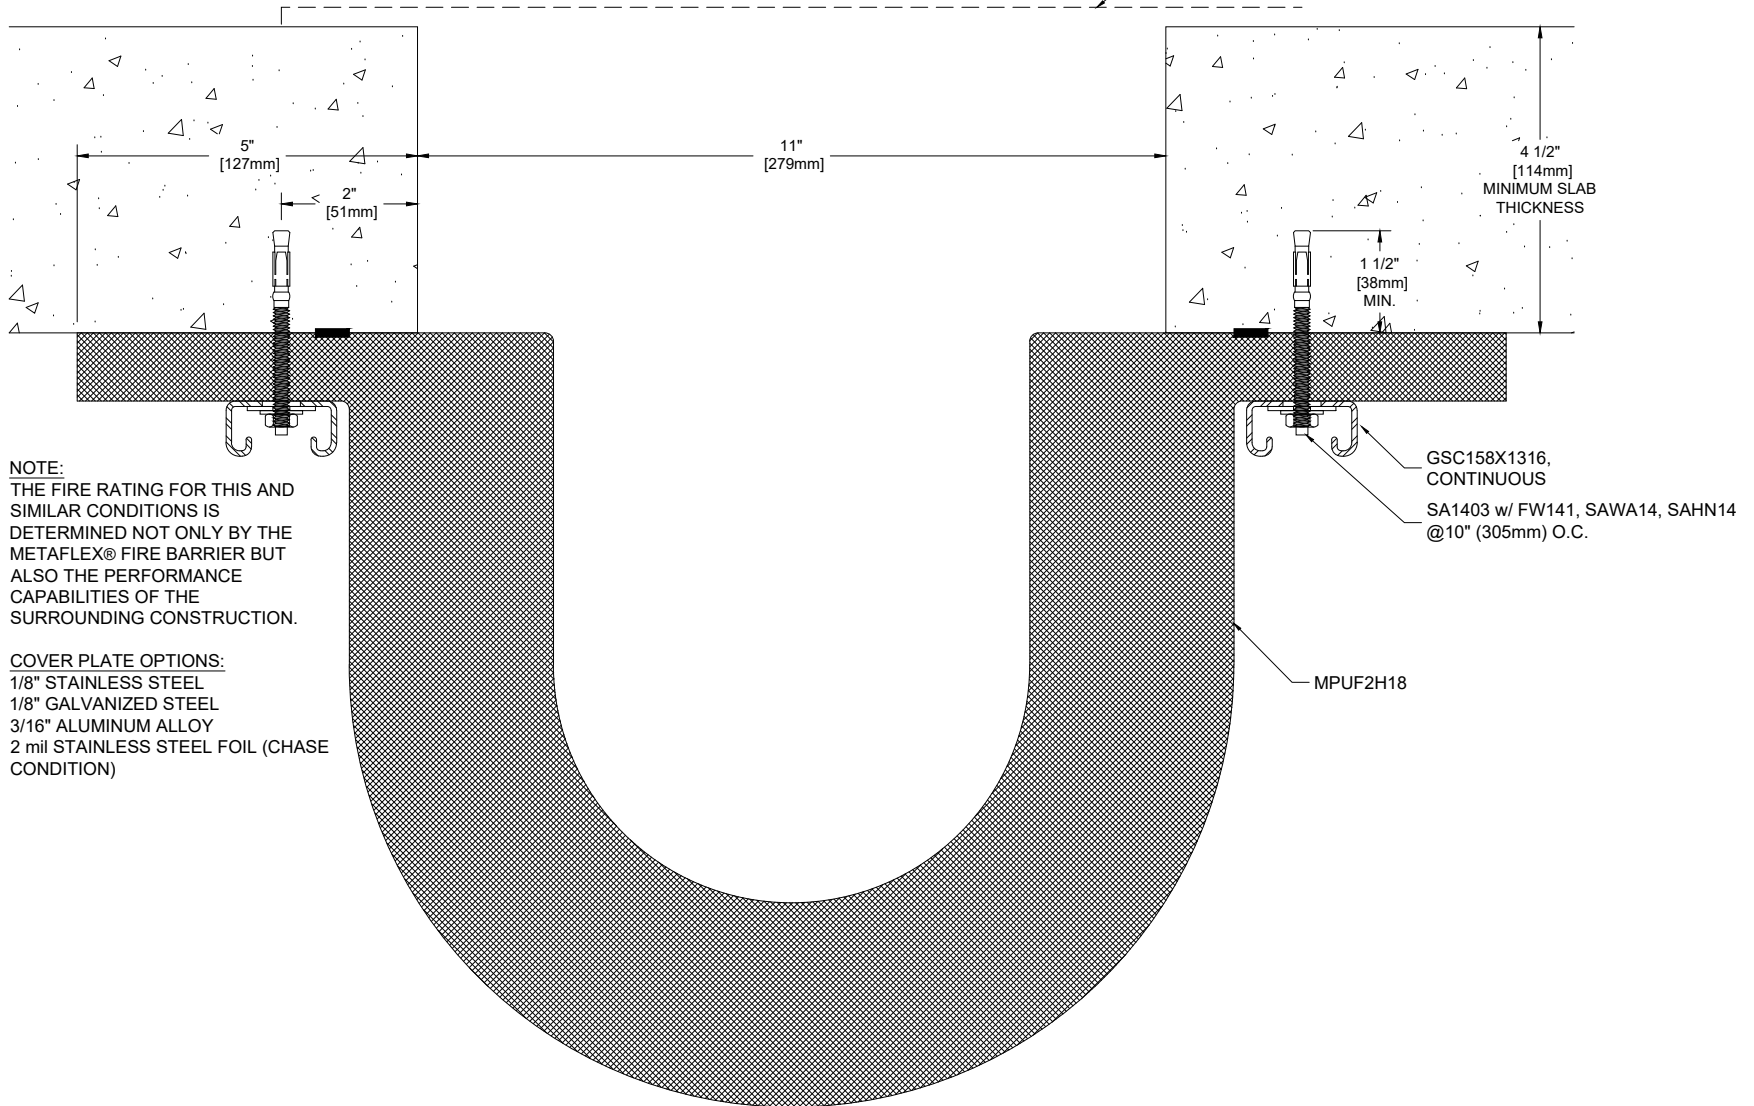

NOTE:
 THE FIRE RATING FOR THIS AND
 SIMILAR CONDITIONS IS
 DETERMINED NOT ONLY BY THE
 METAFLEX® FIRE BARRIER BUT
 ALSO THE PERFORMANCE
 CAPABILITIES OF THE
 SURROUNDING CONSTRUCTION.

COVER PLATE OPTIONS:
 1/8" STAINLESS STEEL
 1/8" GALVANIZED STEEL
 3/16" ALUMINUM ALLOY
 2 mil STAINLESS STEEL FOIL (CHASE
 CONDITION)

GSC158X1316,
 CONTINUOUS
 SA1403 w/ FW141, SAWA14, SAHN14
 @10" (305mm) O.C.

MPUF2H18

Project:	
Customer:	
SO#	
Date:	
Page ___ of ___	Scale: NTS

Length	Qty.	Color

Drawn By: DEB



A CSW Industrials Company

The information contained herein is the proprietary property
 of BALCO®. No portion of it may be reproduced by any means or
 used in any form except for the purpose for which it was furnished.
 All rights of design and invention are hereby reserved.

REV. - 07/14/20