


**MPUF2H33**  
 UNDER-SLAB FLOOR FIRE BARRIER  
 2 HOUR RATED  
 MAXIMUM OPENING 33" (838mm)  
 INTERTEK LISTING # BA/EC 120-02

COVER IS REQUIRED TO MAINTAIN  
 2 HOUR RATING (BY OTHERS)  
 SEE NOTE

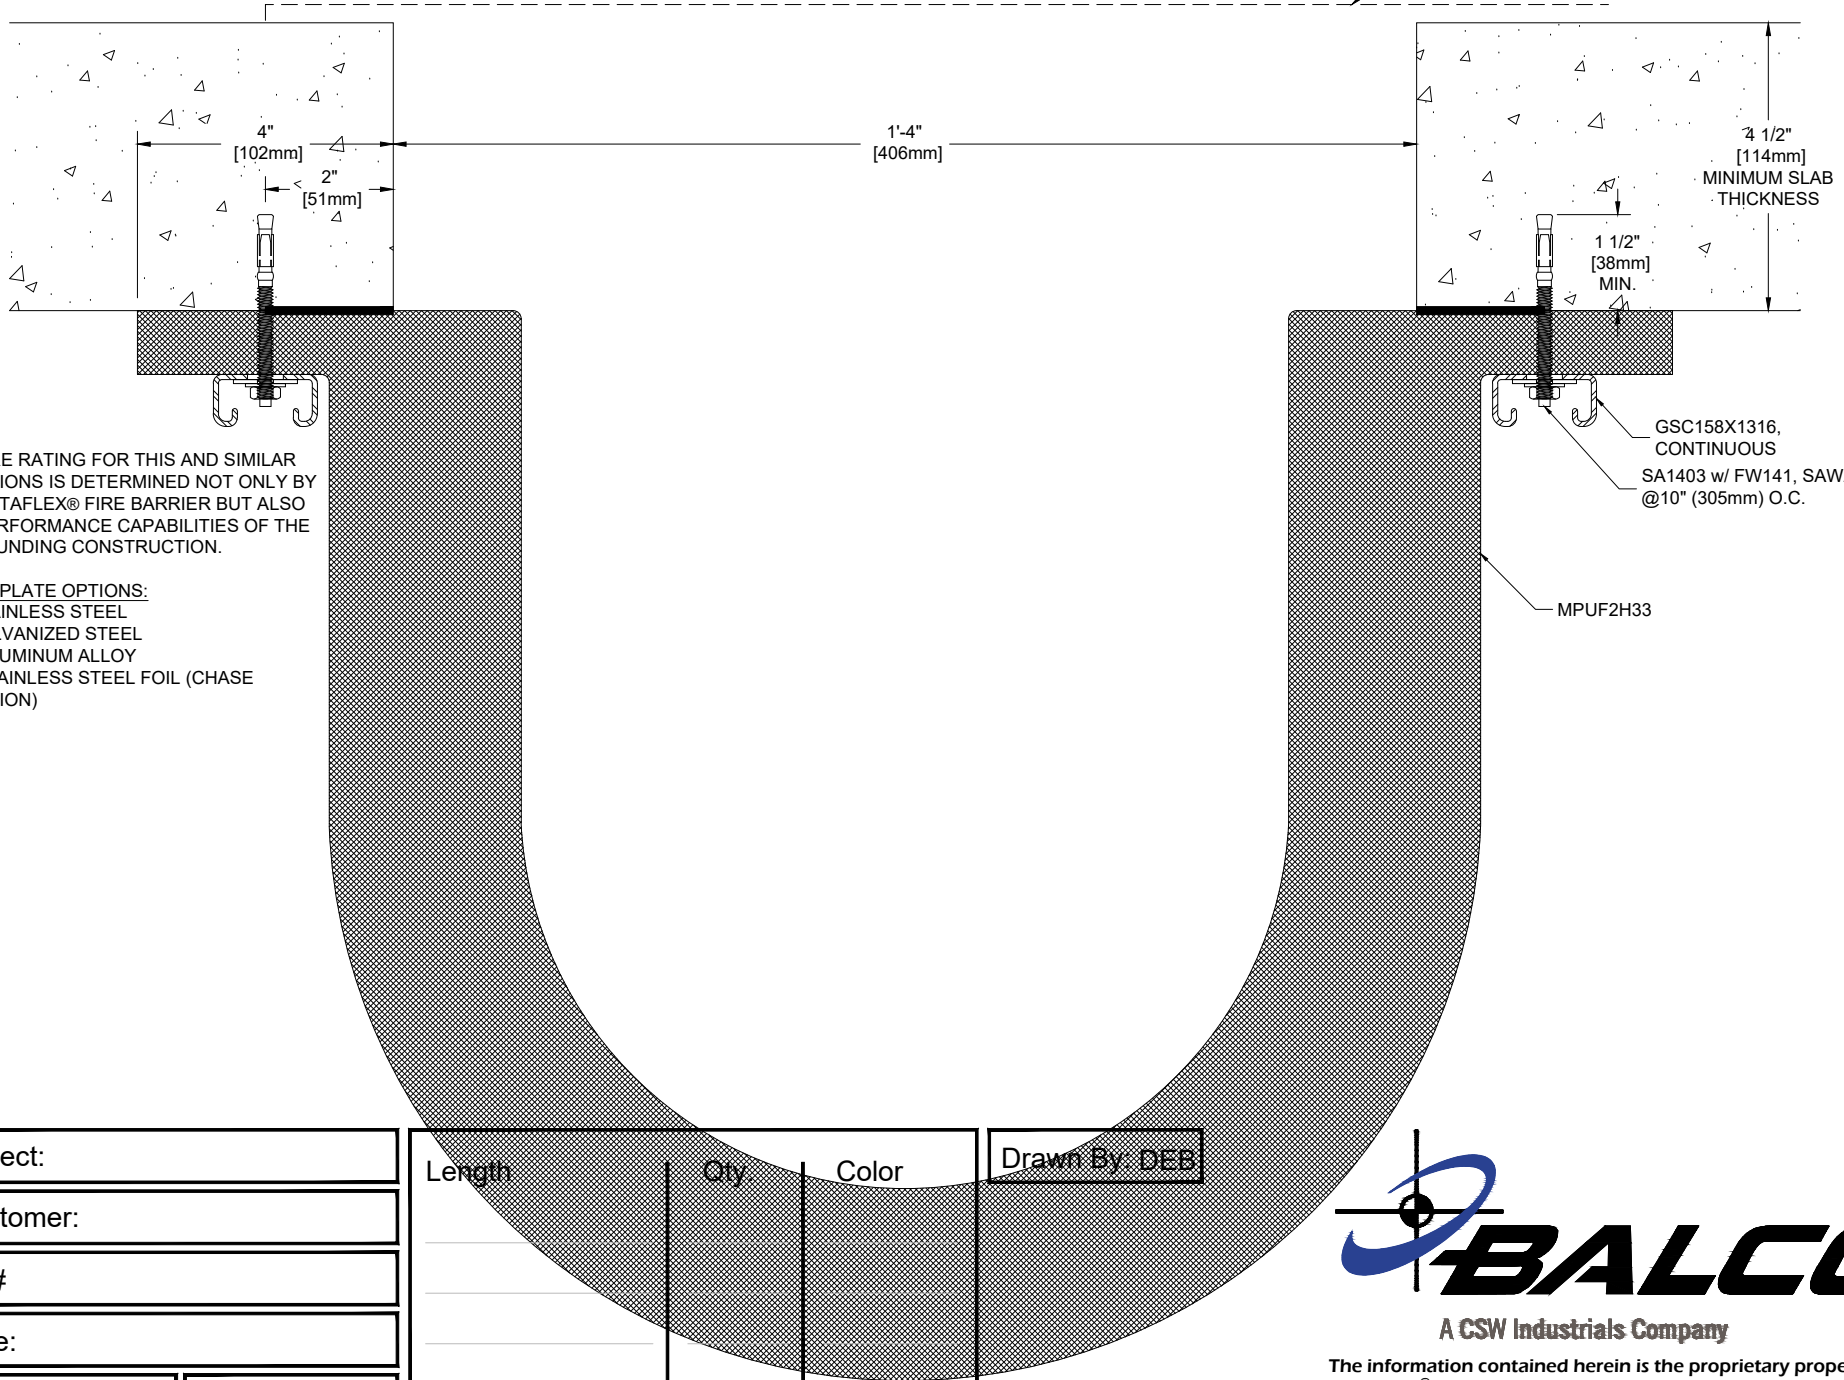

**NOTE:**  
 THE FIRE RATING FOR THIS AND SIMILAR  
 CONDITIONS IS DETERMINED NOT ONLY BY  
 THE METAFLEX® FIRE BARRIER BUT ALSO  
 THE PERFORMANCE CAPABILITIES OF THE  
 SURROUNDING CONSTRUCTION.

**COVER PLATE OPTIONS:**  
 1/8" STAINLESS STEEL  
 1/8" GALVANIZED STEEL  
 3/16" ALUMINUM ALLOY  
 2 mil STAINLESS STEEL FOIL (CHASE  
 CONDITION)

GSC158X1316,  
 CONTINUOUS  
 SA1403 w/ FW141, SAWA14, SAHN14  
 @10" (305mm) O.C.

MPUF2H33

Project:	
Customer:	
SO#	
Date:	
Page ___ of ___	Scale: NTS

Length	Qty.	Color	Drawn By: DEB



The information contained herein is the proprietary property  
 of BALCO®. No portion of it may be reproduced by any means or  
 used in any form except for the purpose for which it was furnished.  
 All rights of design and invention are hereby reserved.

REV. - 07/14/20